US EPA ARCHIVE DOCUMENT

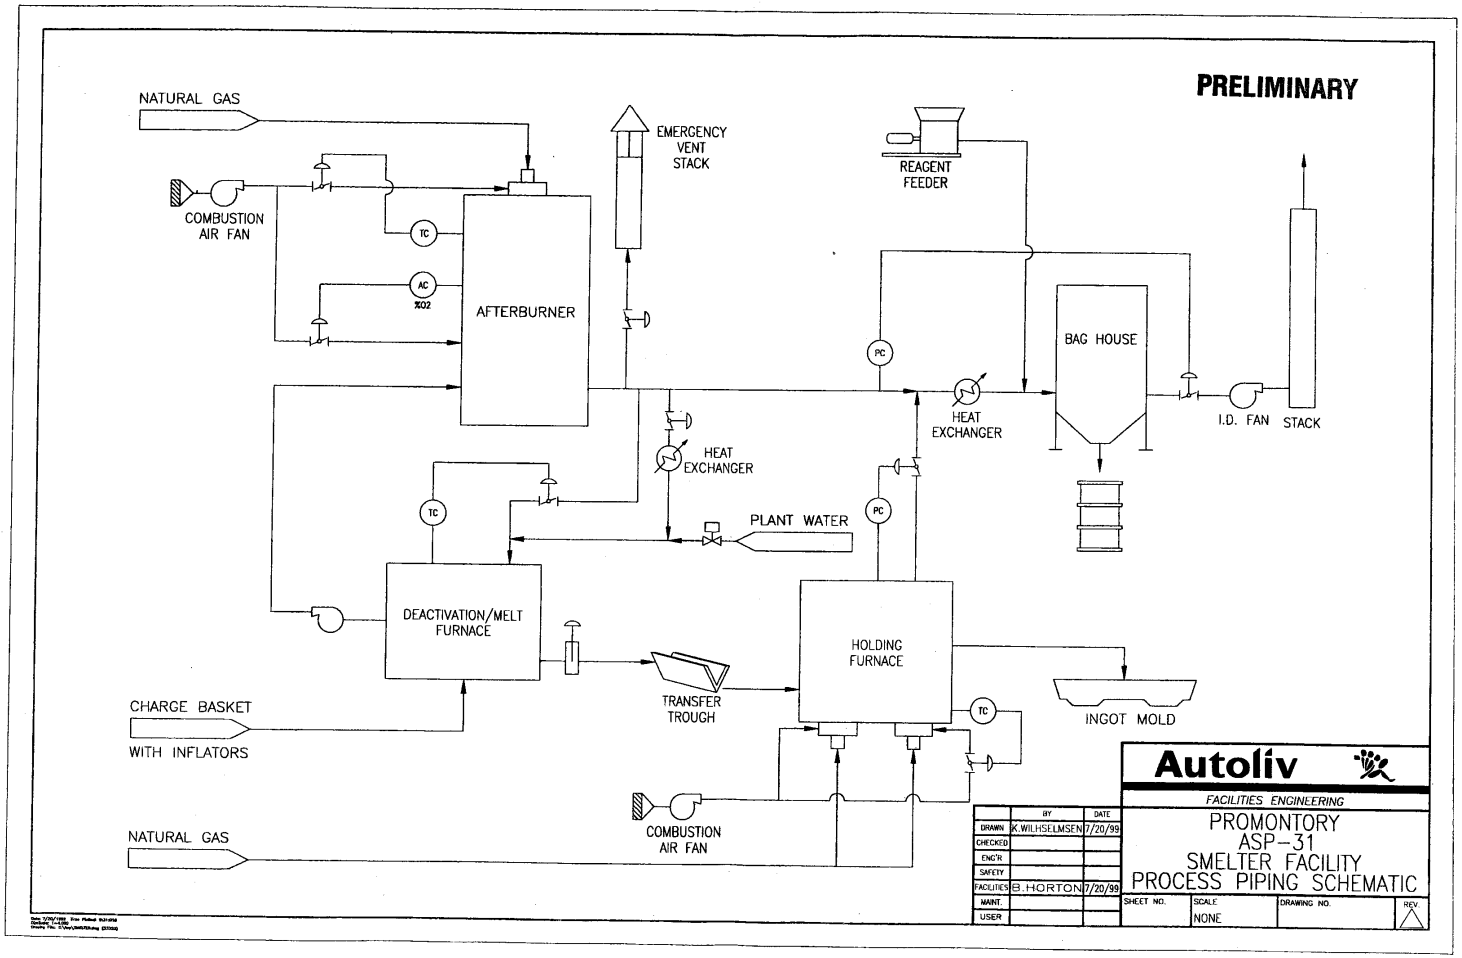
PRELIMINARY
NATURAL GAS
COMBUSTION AIR FAN
TC
AC
%O2
AFTERBURNER
EMERGENCY VENT STACK
REAGENT FEEDER
PC
BAG HOUSE
HEAT EXCHANGER
I.D. FAN
STACK
HEAT EXCHANGER
PLANT WATER
TC
PC
DEACTIVATION/MELT FURNACE
HOLDING FURNACE
TRANSFER TROUGH
INGOT MOLD
TC
CHARGE BASKET
WITH INFLATORS
COMBUSTION AIR FAN
NATURAL GAS
Autoliv
FACILITIES ENGINEERING
PROMONTORY
ASP-31
SMELTER FACILITY
PROCESS PIPING SCHEMATIC
BY
DATE
DRAWN K.WILHSELMSEN 7/20/99
CHECKED
ENG'R
SAFETY
FACILITIES B.HORTON 7/20/99
MAINT.
USER
SHEET NO.
SCALE NONE
DRAWING NO.
REV.