


Firestone Noblesville, IN

Off Site Shallow and Deep Monitoring Well Data from 2002-2004

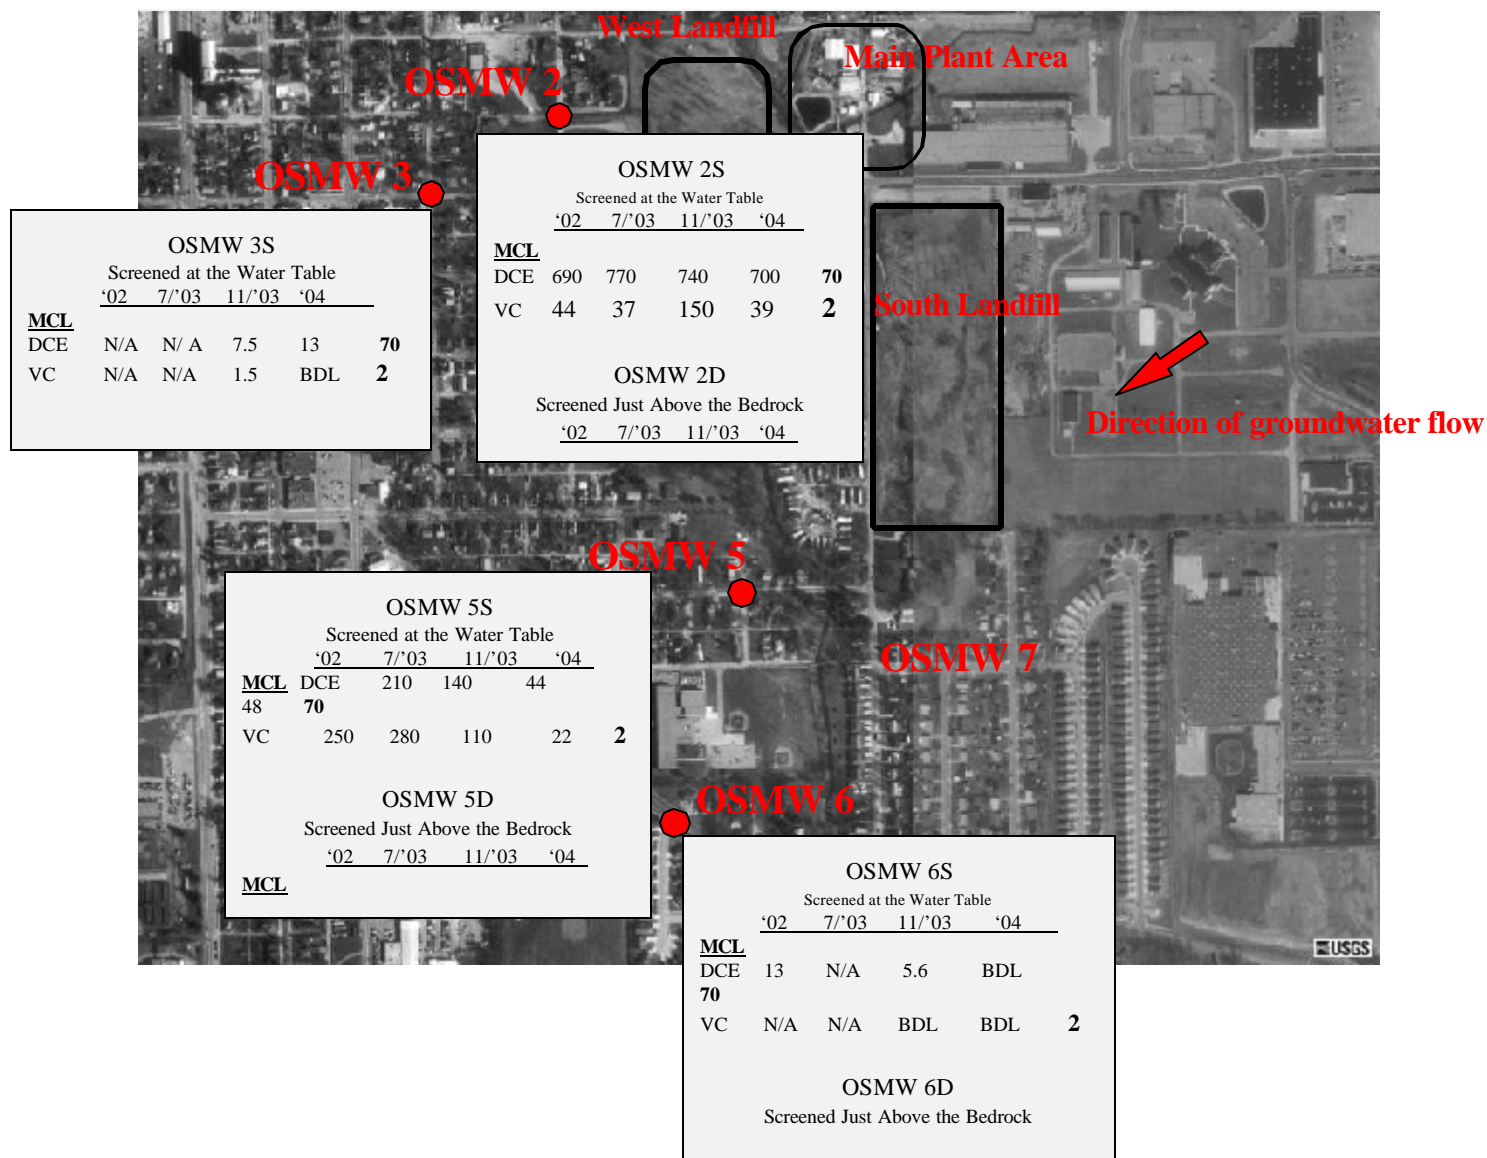

Data in Parts Per Billion

N/A: Sample not available, wells had not been installed. Data from shallow well 6 in 2002 was obtained from a geoprobe prior to the installation of the monitoring well.

BDL: Below Detection Limit

MCL: Maximum Contaminant Level (National Primary Drinking Water Regulations)

