


US EPA ARCHIVE DOCUMENT

Recycled
 Membrane Treated
 Raw Water.

Commissioning Backwash Configuration

Membrane Filtrate returned 2015

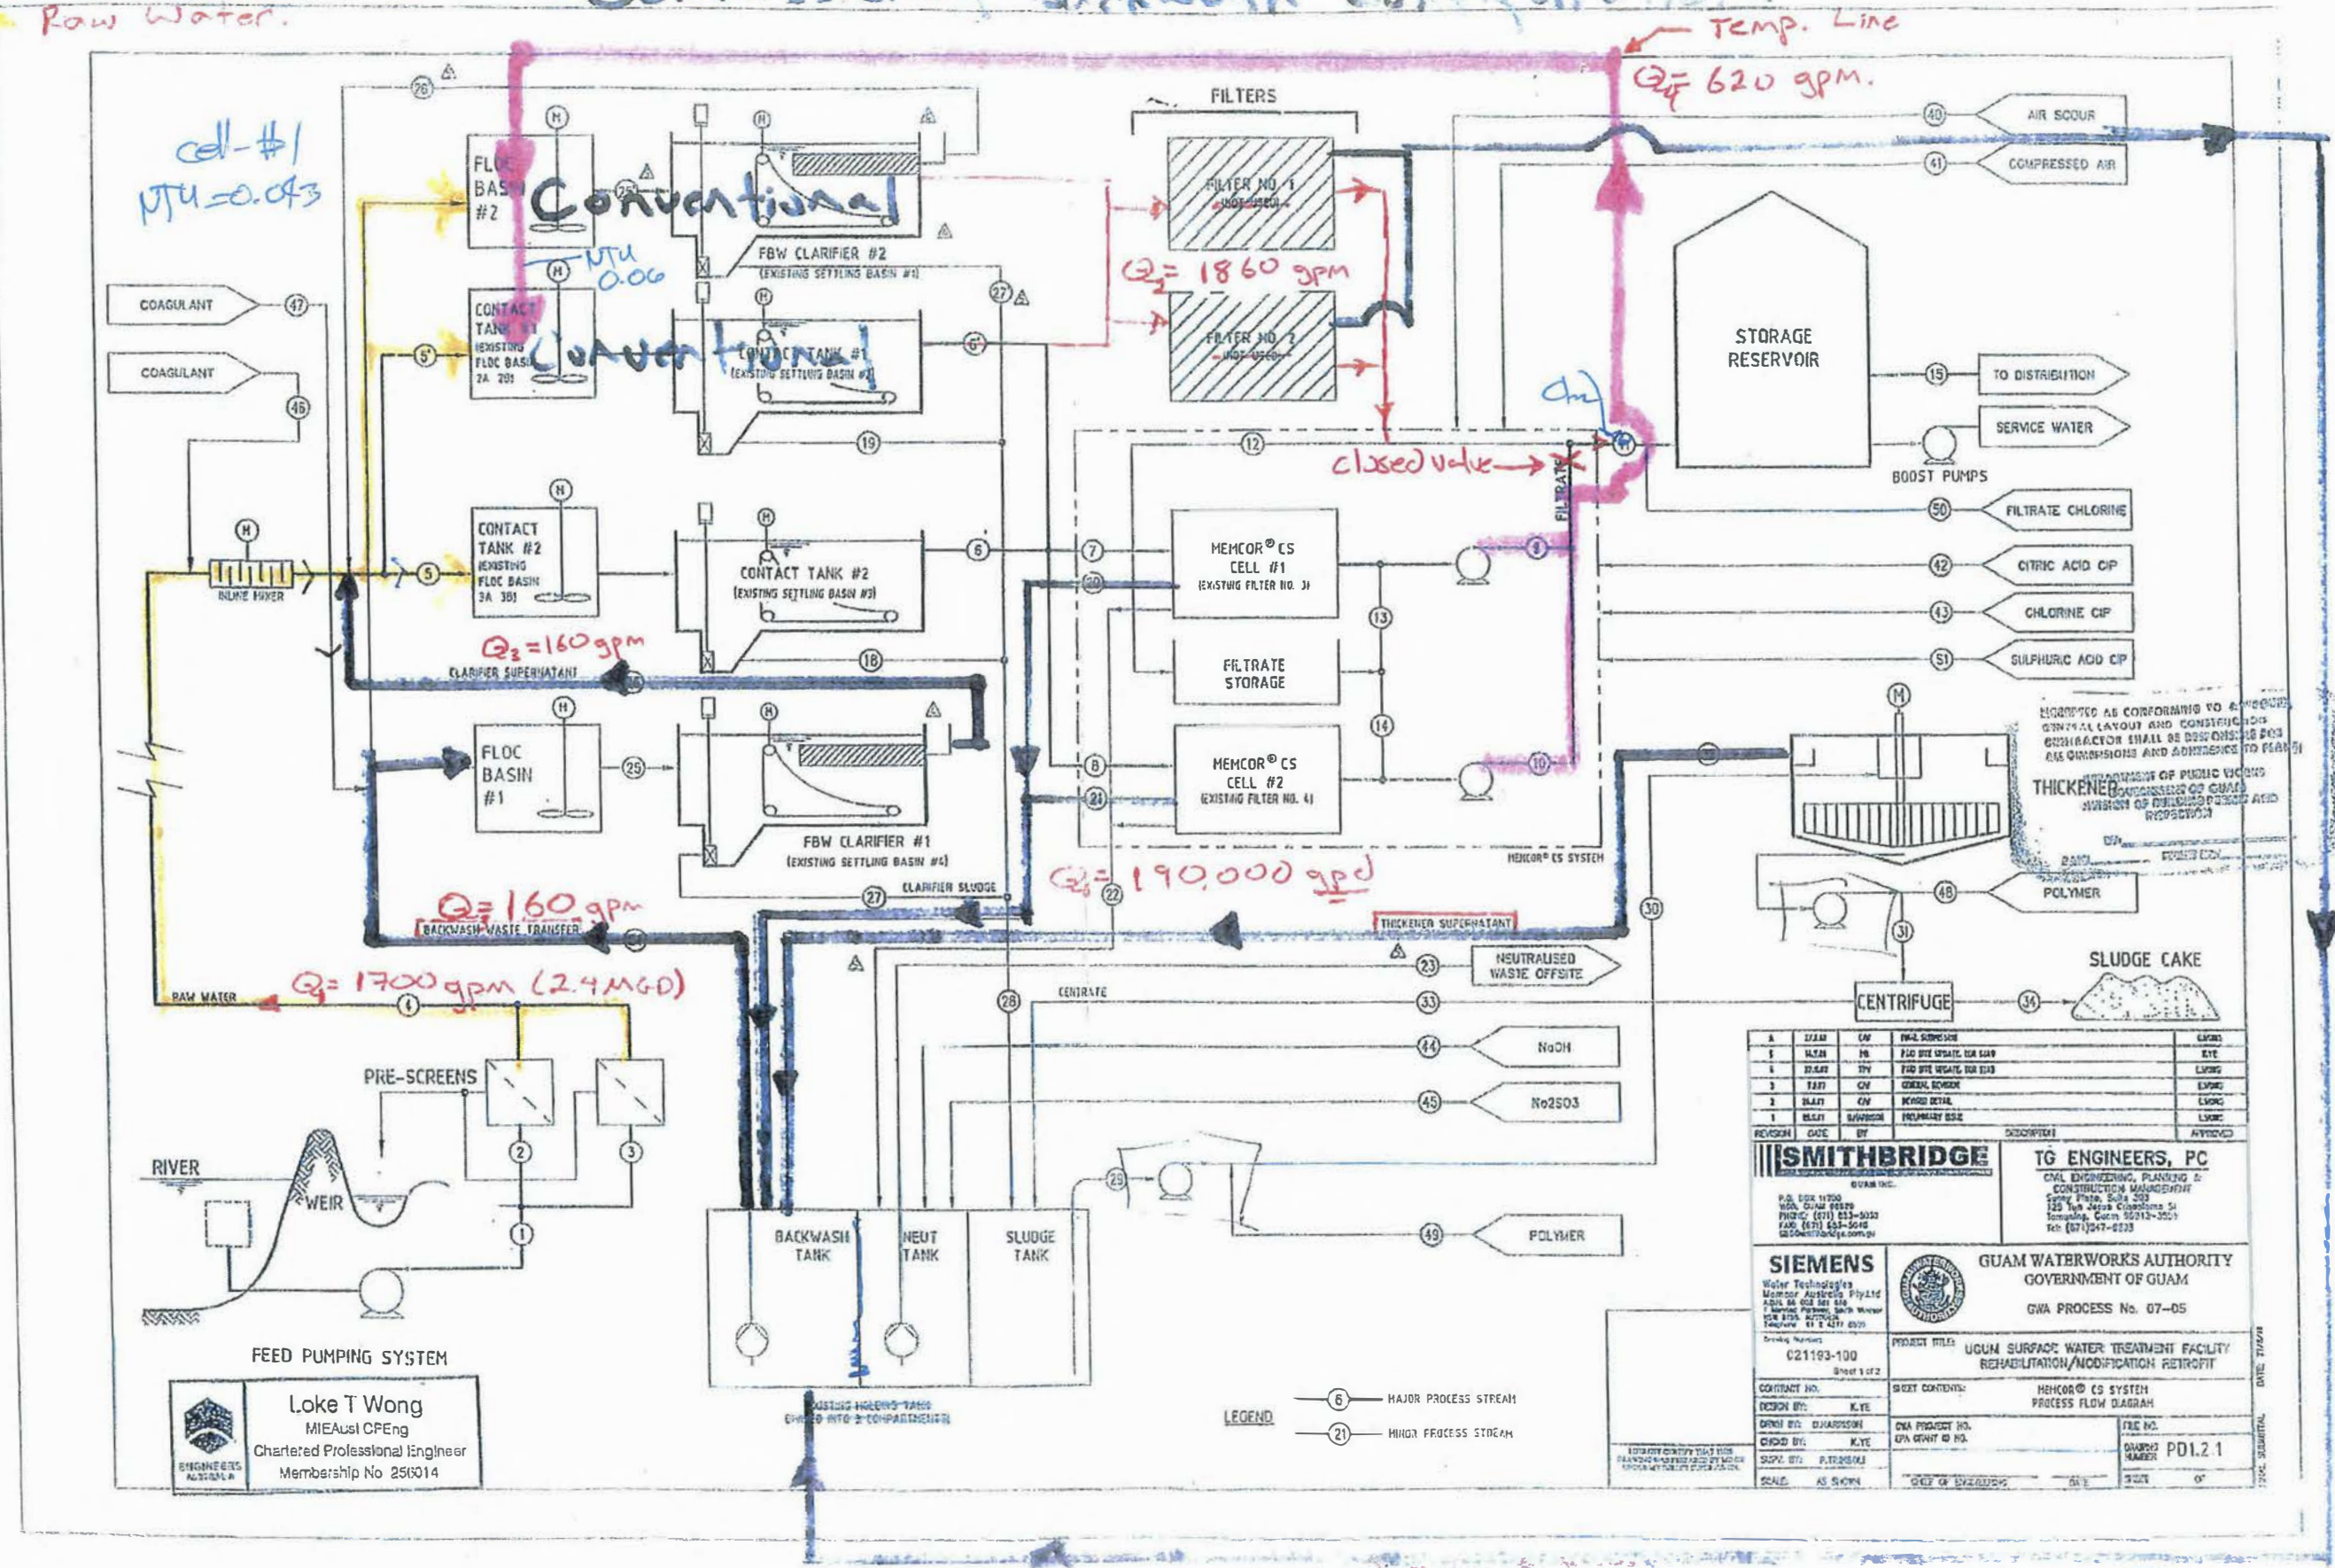

Loke T Wong
 MIEAust CPEng
 Chartered Professional Engineer
 Membership No 256014

REV	DATE	BY	DESCRIPTION	APPROVED
1				
2				
3				
4				
5				
6				
7				
8				
9				
10				
11				
12				
13				
14				
15				
16				
17				
18				
19				
20				
21				
22				
23				
24				
25				
26				
27				
28				
29				
30				
31				
32				
33				
34				
35				
36				
37				
38				
39				
40				
41				
42				
43				
44				
45				
46				
47				
48				
49				
50				
51				

SMITHBRIDGE
 CIVIL ENGINEERING, PLANNING & CONSTRUCTION MANAGEMENT
 125 The Plaza, Suite 200
 Honolulu, Hawaii 96813-2000
 Tel: (808) 551-5000
 Fax: (808) 551-5001
 Email: info@smithbridge.com

TG ENGINEERS, PC
 CIVIL ENGINEERING, PLANNING & CONSTRUCTION MANAGEMENT
 125 The Plaza, Suite 200
 Honolulu, Hawaii 96813-2000
 Tel: (808) 551-5000
 Fax: (808) 551-5001
 Email: info@tgengineers.com

SIEMENS
 Water Technologies
 Memorial Avenue, Plympton
 P.O. Box 11700
 Honolulu, HI 96811-1700
 Phone: (808) 551-5000
 Fax: (808) 551-5001
 Email: info@siemens.com

GUAM WATERWORKS AUTHORITY
 GOVERNMENT OF GUAM
 GWA PROCESS No. 07-05

PROJECT TITLE: UGUM SURFACE WATER TREATMENT FACILITY REHABILITATION/MODIFICATION RETROFIT
 SHEET 1 OF 2
 CONTRACT NO.: C21193-100
 DESIGN BY: K.YE
 CHECK BY: K.YE
 DATE: AS SHOWN
 FILE NO.: PDL2.1
 DRAWING NUMBER: 07